



Fire Risk Statement

Winking Hill

Ref 04875-7720144

Revision History

Issue	Date	Name	Latest changes
01	07/05/2024	William Miskelly	First Created

Contents

1	Introduction	3
2	Project Description	4
2.1	General project information	4
2.2	Battery selection	4
3	Design Factors	5
3.1	Fire response strategy	5
3.2	Mitigation Measures	5
3.2.1	Equipment spacing	5
3.2.2	Protection systems	6
3.2.3	Access to battery storage enclosure	6
3.2.4	Location of BESS facility	6
3.2.5	Access for emergency services	6
3.2.6	Water Supply	6
4	Conclusion	8

1 Introduction

This document forms the Winking Hill BESS fire risk statement. The document indicates how the project has been developed to address fire risk in several ways. It contains key mitigation measures against the risk of fire ignition and propagation within the battery energy storage system (BESS) site.

Battery technology and associated understanding of fire risk is continually evolving within the industry. As such, this document sets out key principles and mitigation measures based on the current understanding of battery fire risk but does not include a detailed Fire Risk Management Plan. A detailed Fire Risk Management Plan would be developed during detailed design, following battery selection.

2 Project Description

2.1 General project information

Renewable Energy Systems Ltd (RES) is developing a 100MW BESS facility. The BESS will consist of 64 no. battery storage enclosures (BSEs), power conversion systems (PCSs), transformers, electrical infrastructure, foundations, access track, crane hardstanding, and spares storage containers. The grid connection will be via an onsite 132kV substation.

2.2 Battery selection

The proposed battery technology for the development is anticipated to be lithium iron phosphate (LFP). LFP has better thermal stability and enters thermal runaway at higher temperatures compared to some other battery chemistries. This is demonstrated by the UL 9540A test results of RES' preferred battery system which show that, at a unit level following deliberate initiation of thermal runaway:

- No flaming outside the initiating battery rack was observed.
- Surface temperatures of modules within the target battery rack adjacent to the initiating battery rack do not exceed the temperature at which thermally initiated cell venting occurs.
- Wall surface temperature rise does not exceed 97°C above ambient.
- Explosion hazards were not observed during the test.

Data from UL9540A testing can also be used to inform detailed design of the site and safety systems.

Each BSE has an approximate capacity of 1.75MW / 3.7MWh and footprint of approximately 6.1 x 2.4m. The exact battery form factor will be determined during detail design phase.

3 Design Factors

3.1 Fire response strategy

It is the intention that the site would be self-sufficient during a potential battery-based fire event and would not require fire service intervention to prevent fire spread or any other significant risks to people or property. Key principles of the NFCC Grid Scale Battery Energy Storage System planning - Guidance for FRS, 2023 (“the NFCC Guidance”) are addressed through the mitigations identified within this report, as these pertain to the fire risk management strategy set out below.

The overarching fire risk management strategy would adopt the following controls:

1. Implement measures that result in a very low risk of fire ignition and any suitable environment for sustaining fire.
2. Implement measures that result in a very low risk of fire propagation and spread within a fire source (e.g. BSE).
3. Ensure fire spread between significant elements of the project is not expected, through application of design standards and use of calculations / modelling as necessary.
4. Include adequate provisions to allow the fire service to monitor a fire event, intervening only if there is a failure of the controls above.

Due to the risks associated with lithium-ion fires, transformer fires, and high-power equipment, there are significant safety benefits to minimising fire service intervention and consequential firefighter hazard exposure.

During detailed design, following battery product selection, a project specific Fire Risk Management Plan will be developed, in liaison with the Fire Service and with due consideration of the NFCC Guidance. This Fire Risk Management Plan will include:

- A fire risk appraisal that details how the fire response strategy above will be achieved, including the identification and design of any further mitigations required to achieve the strategy above.
- An emergency response plan.

3.2 Mitigation Measures

The following points define the key preliminary design mitigations against the risk of fire ignition and propagation within the BESS site.

3.2.1 Equipment spacing

The site has been developed to include adequate spacing between the battery storage enclosure (BSE) to mitigate against the risk of fire spread in the event of a fire within one BSE. The site layout aligns with applicable NFPA 855 spacing criteria as well as the spacing recommendations outlined in FM Global Property

Loss Prevention Datasheet 5-33 (Interim revision July 2023). The layout allows minimum distance of 3m between batteries enclosures and any other infrastructure.

3.2.2 Protection systems

Each BSE will have a dedicated fire protection system, comprising flammable gas detection and venting, fire detection and alarm, and an automatic fire suppression system. Additionally, key battery health and environment parameters will be continuously monitored with alarms sent to a control centre. Automatic electrical disconnection will be enacted by the battery management system should operational temperature, current or voltage limits be breached. There will be levels of alarms prior to protection limits which warn the operator of proximity to safe operating limits. BSEs will be fitted with deflagration venting and explosion protection appropriate to the hazard.

3.2.3 Access to battery storage enclosure

All BSEs will be accessed via external doors only, i.e. no internal corridor to eliminate the risk of people being inside an enclosure during a fire or thermal runaway gas venting incident.

3.2.4 Location of BESS facility

The location of the facility has been selected considering the distances from existing nearby premises. There are no premises nearby site, with the nearest one to site to be more than 60m in distance. A distance of at least 5m is achieved between BSEs and the site boundary, in line with NFPA 855 (2023), and there is no existing or planned bushes or trees within 7m of any BSE.

3.2.5 Access for emergency services

The fenced BESS compound has a wide access route from the Northeast and Southeast and through centre, allowing the fire service to access the site during an incident. In addition, two site access points have been proposed to ensure that fire services would have an alternative option for approaching site if the combination of wind direction and smoke made one direction particularly onerous.

Turning locations for emergency response vehicles are available within the site hardstandings.

Vehicular access to allow the emergency services to safely reach the development during design flood conditions has been considered and achieved.

3.2.6 Water Supply

A washout chamber is located approximately 60m to the East of the site and has been shown in figure 1 & the coordinates shown in table 1.

It is intended that an onsite water supply would not be required to achieve the fire response strategy outlined in 3.1. However, if agreed as necessary in development of the Fire Response Plan, a supply of 1,900 litres per minute for at least 2 hours in line with the NFCC Guidance could be achieved through provision of a hydrant connected to the nearby clean water mains or a tank at the potential location identified in Figure 1 at the coordinates shown in table 1.

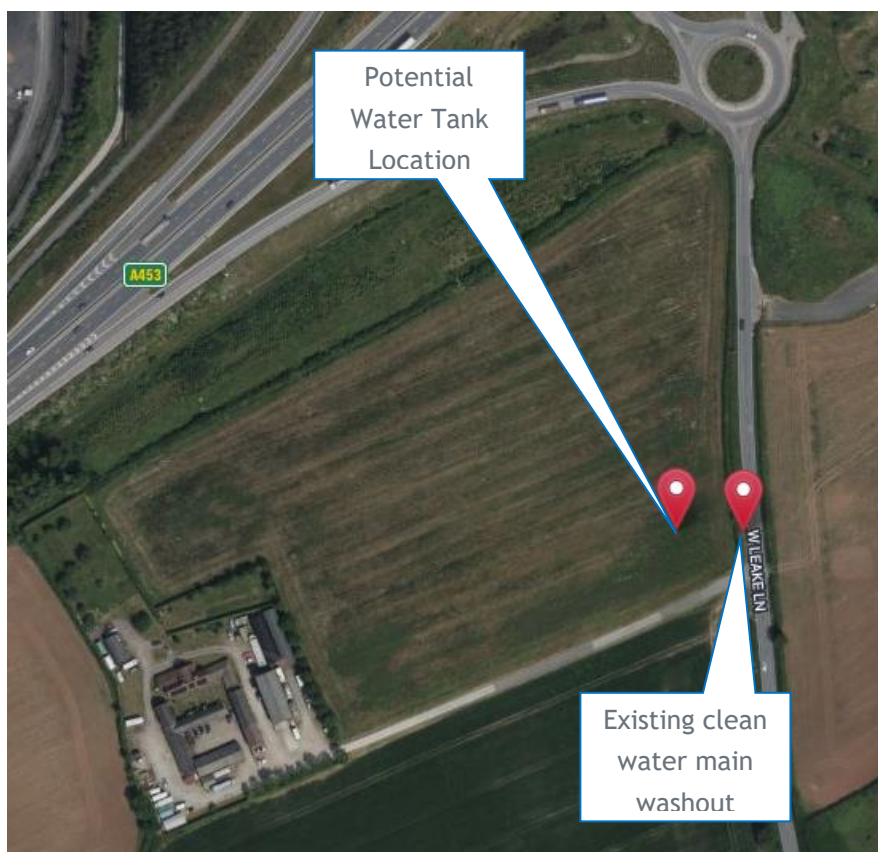


Figure 1 Potential water supply point locations

Table 1 - Location of Potential Water Supplies

Water Supply Provision	Easting	Northing	What 3 words
Existing clean water main washout	451214	329813	advancing.earphones.ribs.
Potential Water Tank Location	451184	329813	Grasp.sprouted.blotchy

4 Conclusion

During the preliminary design, efforts have been made to mitigate, minimise, and prevent any fire hazard on site by incorporating specific design factors as described in this document. During detailed design and following battery product selection, a project specific fire risk appraisal will be used to verify the strategy presented in this document and an emergency response plan will be developed through liaison with the local fire service.